

Test laboratory for the fire behavior of building materials, Dipl.-Ing. (FH) Andreas Hoch
Testing, supervising and certifying body, authorized by the building supervision authority

TEST REPORT

PZ-Hoch-200700-2

for the proof of Fire behaviour according to DIN 4102, part 1

Translation of the German test report – no guarantee for translation of technical terms

company	Zimmer + Rohde GmbH Zimmersmühlenweg 14-18 D-61440 Oberursel
description of samples	fabric consisting of Polyester and Trevira, in 3 different colours
name of the material	„10886 Solice MAT RE FR“
sampling	by the company itself
content of request	Proof of flammability to classify building materials to class B1 “schwerentflammbar” according to DIN 4102, part 1
validity of test report	31.07.2025
result	The examined product meets in any colour the requirements of class B1 for “schwerentflammbare” (hardly flammable) building materials according to DIN 4102, part 1 (May 1998) , suspended freely or with distance of >40 mm to same or other plain materials.

This test report includes 5 pages and 7 enclosures.

Remark: If the above mentioned building material is not used as product according to MBO § 2, Abs. 9, Ziffer 1, there is no need for a general building supervisory test report.

This test report is not valid if the examined building material is used as product in the meaning of state building prescriptions (MBO § 17, Abs. 3).

This test report does not replace an eventually necessary proof of applicability concerning building supervisory or building laws in the meaning of state building prescriptions. This has to be verified by:

- “allgemeine bauaufsichtliche Zulassung” (general building inspectorate approval) or by
- „allgemeines bauaufsichtliches Prüfzeugnis“ (general building inspectorate certificate) or by
- “Zustimmung im Einzelfall” (exceptional approval)

This test report can underlie building supervisory procedures

- for regular building products for the prescribed proofs of conformity
- for non regular building products for the needed proofs of applicability.

This test report must not be published and copied without preceding agreement of the test laboratory and if agreed, only during validity and unchanged concerning appearance and contents.

1. Description of test material in condition as delivered

PN 31628: „10886 Solice MAT RE FR” colour: **brown**

-fabric consisting of 52% Polyester and 48% Trevira-
side A: smoother surface

characteristic values determined by the test laboratory:

area weight: about 281 g/m² thickness: about 0,57 mm

PN 31629: as PN 31628, however in **white**

characteristic values determined by the test laboratory:

area weight: about 267 g/m² thickness: about 0,50 mm

PN 31630: as PN 31628, however in **red**

characteristic values determined by the test laboratory:

area weight: about 269 g/m² thickness: about 0,47 mm

The testing laboratory is not provided with further details concerning composition of the tested building materials. Samples are deposited.


2. Preparation of samples

The samples were kept in climate chamber 23/50 until they reached constant weight.

3. Arrangement of samples mounting: freely suspended

#3739	flaming side A in warp direction	white
#3741	flaming side B in warp direction	white
#3743	flaming side B in weft direction	white
#3744	flaming side B in warp direction	brown
#3745	flaming side B in warp direction	red

4. Date of test CW 31 in 2020



5. Results The test has been examined according to DIN 4102 (Mai 1998)

line no.	Measurement	Result with the tested specimen					Dim.
	Test number	#3739	#3741	#3743	#3744	#3745	
	flamed direction	warp	warp	weft	warp	warp	
	flamed side	A	B	B	B	B	
	<u>colour of fabric</u>	white			brown	red	
1	<u>Number of specimen arrangement</u> acc. to. DIN 4102/T15, schedule 1	1	1	1	1	1	
2	<u>Maximum flame height above bottom</u> <u>edge of the specimen</u>	30	30	30	30	30	cm
3	<u>Time</u> ¹⁾	0:02	0:02	0:02	0:02	0:02	min:s
4	<u>Burn through / melting</u> <u>Time</u> ¹⁾	0:04	0:04	0:04	0:04	0:04	min:s
5	<u>Observations on the back side of the specimen</u> <u>Flames / Glowing</u> <u>Time</u> ¹⁾	./.	./.	./.	./.	./.	min:s
6	<u>Change of color</u> <u>Time</u> ¹⁾	./.	./.	./.	./.	./.	min:s
7	<u>Falling of burning droplets</u> <u>Start</u> ¹⁾	./.	./.	./.	./.	./.	min:s
8	<u>Extent</u>	./.	./.	./.	./.	./.	
9	<u>sporatic falling of burning droplets</u> ²⁾	./.	./.	./.	./.	./.	min:s
10	<u>continuous falling of burning droplets</u> ²⁾	./.	./.	./.	./.	./.	
11	<u>Falling of burning droplets</u> <u>Start</u> ¹⁾	./.	./.	./.	./.	./.	min:s
12	<u>Extent</u>	./.	./.	./.	./.	./.	
13	<u>sporatic falling of burning droplets</u> ²⁾	./.	./.	./.	./.	./.	min:s
14	<u>continuous falling of burning droplets</u> ²⁾	./.	./.	./.	./.	./.	
15	<u>Afterflame time at the bottom of the</u> <u>sieve (max.)</u>	./.	./.	./.	./.	./.	min:s
16	<u>Impairment of the burner by dropping</u> <u>or falling material:</u> <u>Time</u> ¹⁾	./.	./.	./.	./.	./.	min:s
17	<u>Premature end of test</u> <u>Final occurrence of burning at the</u> <u>specimen</u> ¹⁾	./.	./.	./.	./.	./.	min:s
18	<u>Time of eventually end of test</u> ¹⁾	./.	./.	./.	./.	./.	min:s
19	<u>Afterflame after end of test</u> <u>Time</u> ¹⁾	./.	./.	./.	./.	./.	min:s
20	<u>Number of specimen</u>	./.	./.	./.	./.	./.	
21	<u>Front side of specimen</u> ²⁾	./.	./.	./.	./.	./.	
	<u>Back side of specimen</u> ²⁾	./.	./.	./.	./.	./.	
	<u>flame length</u>	./.	./.	./.	./.	./.	cm

line no.	Measurement	Result with the tested specimen					Dim.
	Test number	#3739	#3741	#3743	#3744	#3745	
	flamed direction	warp	warp	weft	warp	warp	
	flamed side	A	B	B	B	B	
22	<u>Afterglow after end of test</u>	./.	./.	./.	./.	./.	min:s
	Time ¹⁾	./.	./.	./.	./.	./.	
23	Number of specimen	./.	./.	./.	./.	./.	
	Place of appearance	./.	./.	./.	./.	./.	
24	Lower half of the specimen ²⁾	./.	./.	./.	./.	./.	
25	Upper half of the specimen ²⁾	./.	./.	./.	./.	./.	
26	Front side of specimen ²⁾	./.	./.	./.	./.	./.	
27	Back side of specimen ²⁾	./.	./.	./.	./.	./.	
28	<u>Density of smoke</u>						
	≤ 400 % * min	1	1	1	1	1	% * min
29	> 400 % * min ⁴⁾	./.	./.	./.	./.	./.	% * min
30	Diagram: encl. no.	1	2	3	4	5	
31	<u>Residual lengths:</u> individual value ³⁾						
	Specimen 1	64	66	68	69	67	cm
	Specimen 2	70	64	71	67	65	cm
	Specimen 3	72	61	64	62	65	cm
	Specimen 4	78	69	70	68	69	cm
32	<u>Average value, individual test</u> ³⁾	71	65	68	67	67	
33	<u>Photo of specimen in enclosure no.</u>	1	2	3	4	5	
34	<u>Flue gas temperature</u>	112	117	118	116	118	°C
35	Maximum of average value						
	Time ¹⁾	10:00	09:08	09:45	07:21	10:00	min:s
36	Diagram: encl. no.	1	2	3	4	5	
37	Remarks: - none -						

¹⁾ indication of times: from the begin of testing procedure ²⁾ checked off if applicable

³⁾ indication of carrier/foam layer separated in case of fire-proofing agents

⁴⁾ very strong development of smoke



6. Explanations concerning the testing procedure

There were no additional tests proceeded because of the residual length of \geq than 45 cm.

7. Summary of results and additional establishments to Fire Behaviour

line o.	measurement	Result with the tested specimen					Dim.
	test-no.	#3739	#3741	#3743	#3744	#3745	
	flamed direction flamed side	warp A	warp B	weft B	warp B	warp B	
	colour of fabric	white			brown	red	
1	residual length	71	65	68	67	67	cm
2	max. smoke temperature	112	117	118	116	118	°C
3	density of smoke - integral	1	1	1	1	1	%min
4	remarks: none						

According to DIN 4102, part 1, "schwerentflammbare" (hardly flammable) building materials must meet the requirements of class B2.

Pursuant to additional tests in the ignitability apparatus this can be determined (appendix 6 & 7).

8. Special remarks


- This report is only valid for the material as described under paragraph 1. In combination with other materials or with additional coatings or grounds etc. the burning behaviour may differ.
- This test report is not valid for the exposure to outdoor climate conditions, washing or cleaning with chemicals.
- This test report is not valid, as soon as the fabric is used as a building product in the sense of the "Landesbauordnungen" (state building requirements, MBO § 17, par. 3).
- This test report is no substitute for a General Building Inspectorate Certificate.
- This test report is granted without prejudice to the rights of third parties, in particular private proprietary rights.
- For legal interests only the German original version is relevant.
- In General Building Inspectorates procedures this test report can be based for
 - regular building materials for the required proof of accordance
 - for not regular building materials for the required proof of applicability

9. Validity

This test report is valid until the mentioned date on page 1. The test report becomes invalid in case the standards on which the tests are based are changed.

Fladungen, 17.09.2020

clerk in charge:


(Dipl.-Ing. (FH) Diana Günzel)



Head of the test laboratory:


(Dipl.-Ing. (FH) Andreas Hoch)

„Brandschacht“-test #3739




measurement

#3739, PN31629: Zimmer + Rohde GmbH, „10886 Solice MAT RE

FR”, A+K

max. Rauchtemperatur: 112°C, Rauch-Integral: 1%min

Restlänge: 71 cm

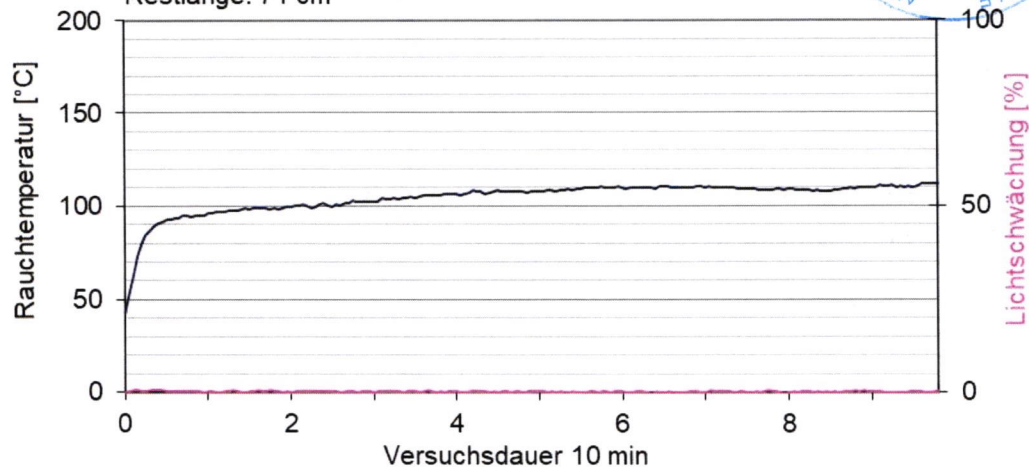

„Brandschacht“-test #3741





measurement


#3741, PN31629: Zimmer + Rohde GmbH, „10886 Solice MAT RE FR“, B+K

max. Rauchtemperatur: 117°C, Rauch-Integral: 1%/min

Restlänge: 65 cm

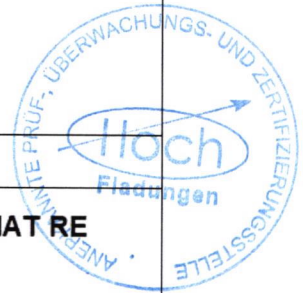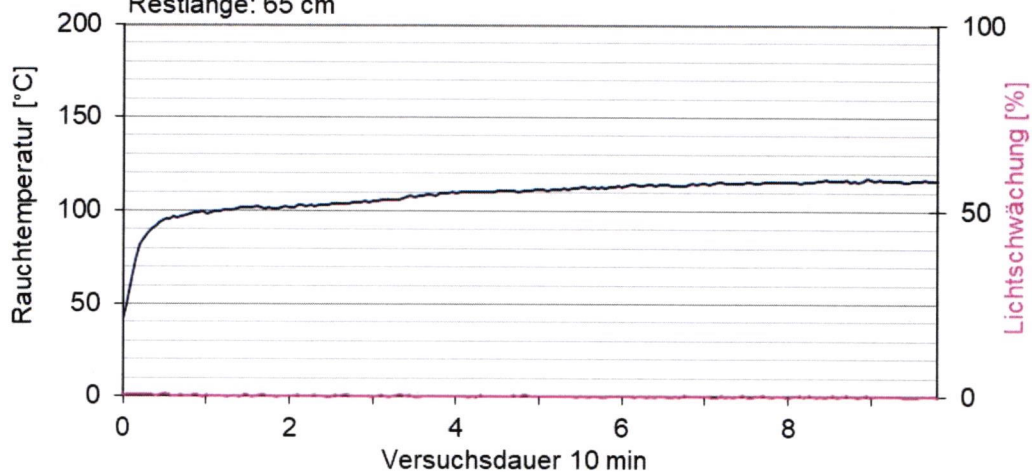


„Brandschacht“-test #3743

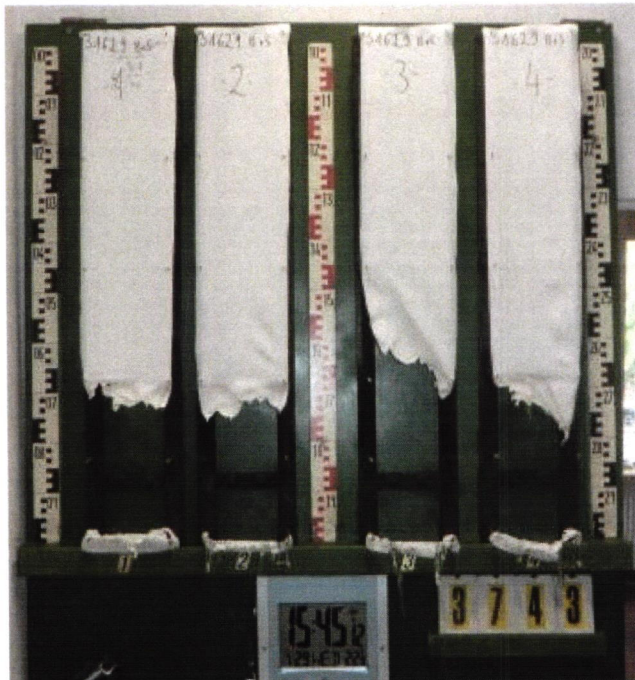


measurement

#3743, PN31629: Zimmer + Rohde GmbH, „10886 Solice MAT RE FR“, B+S

max. Rauchtemperatur: 118°C, Rauch-Integral: 1%/min
Restlänge: 68 cm

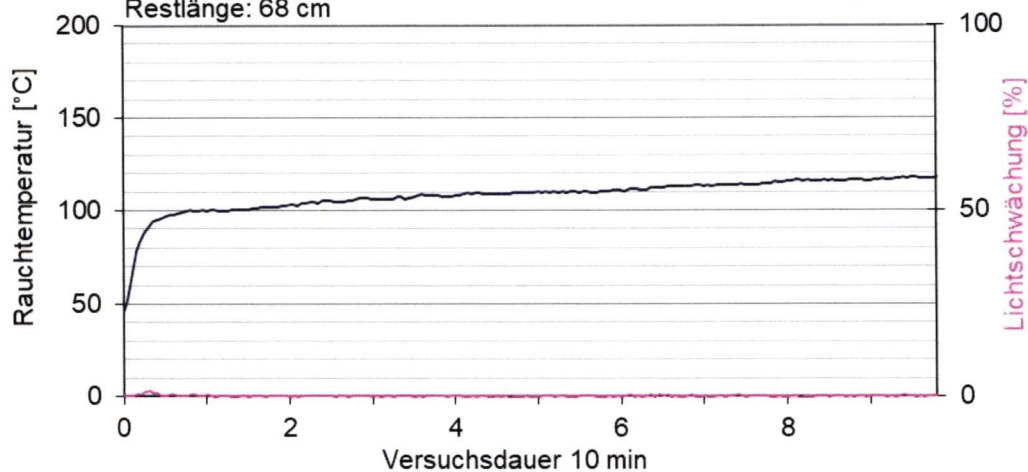


„Brandschacht“-test #3744

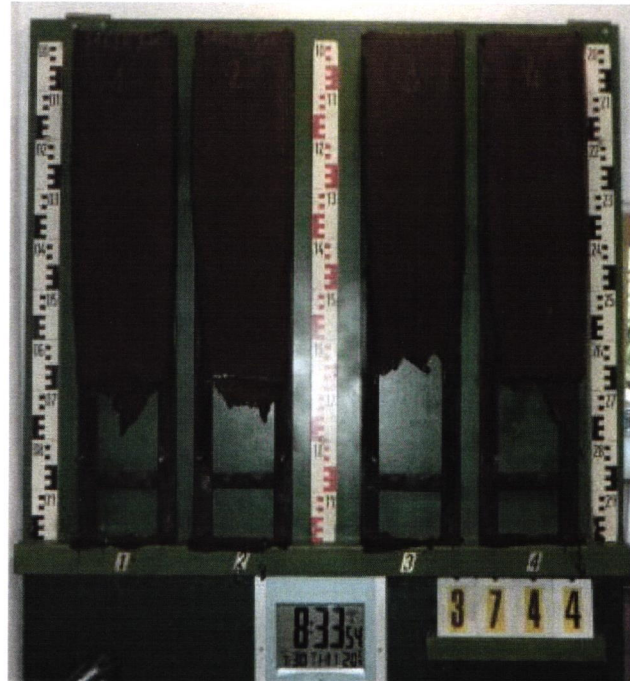


measurement

#3744, PN31628: Zimmer + Rohde GmbH, „10886 Solice MAT, RE FR“, B+K
max. Rauchtemperatur: 116°C, Rauch-Integral: 1%/min
Restlänge: 67 cm

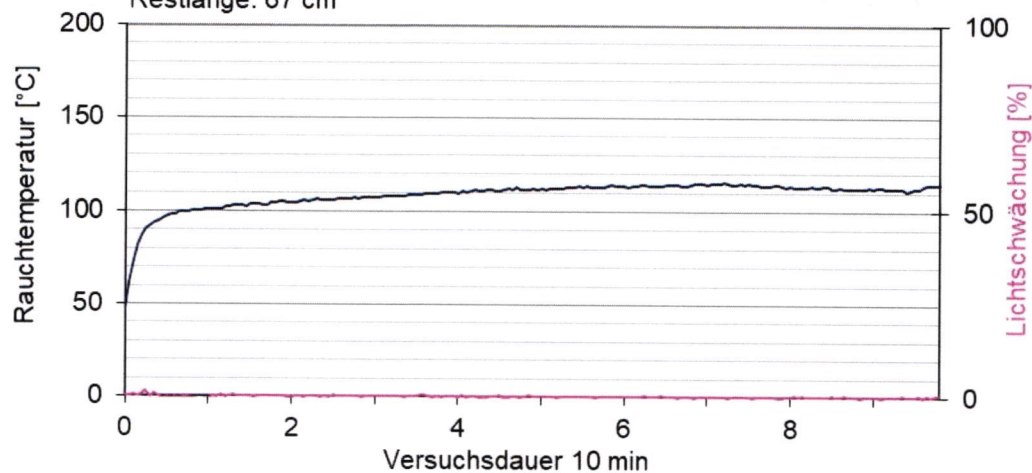


„Brandschacht“-test #3745

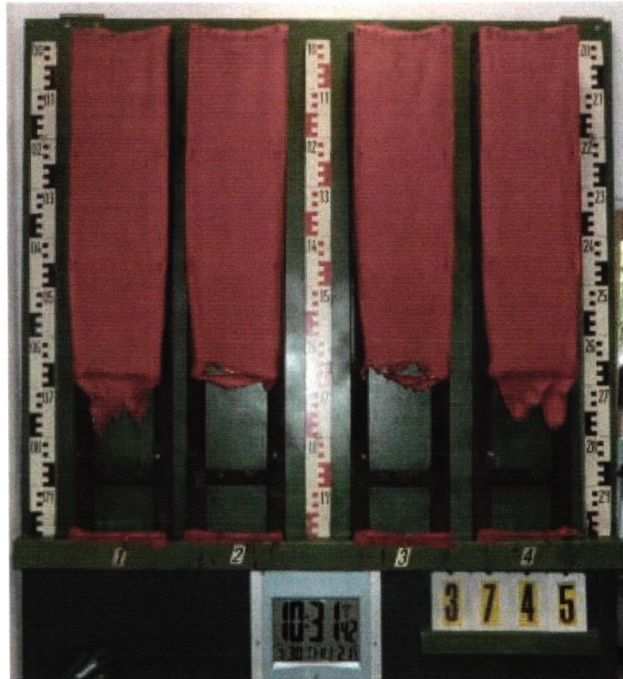

measurement

**#3745, PN31630: Zimmer + Rohde GmbH, „10886 Solice MAT RE
FR“, B+K**
max. Rauchtemperatur: 118°C, Rauch-Integral: 1%min
Restlänge: 67 cm

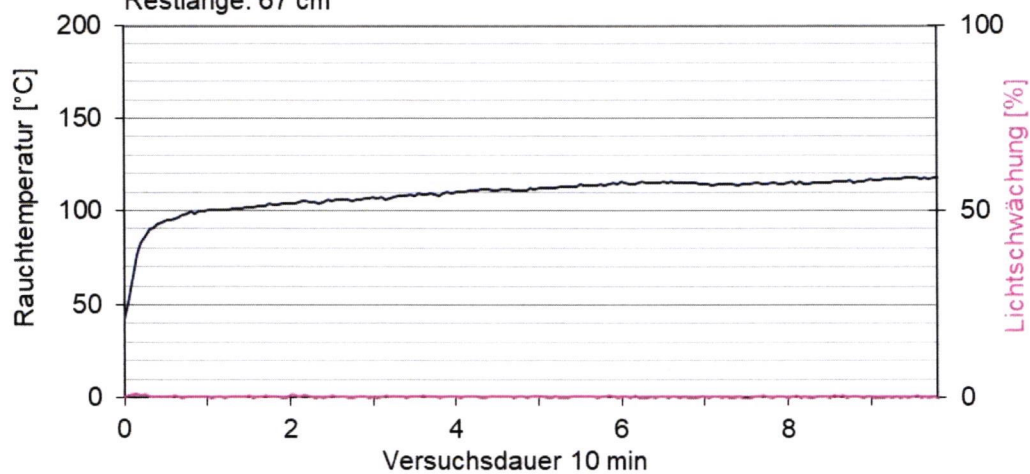

**Test for normal flammability
classifying B2 according to DIN 4102**

1. Description of test material in condition as delivered look at page 2

2. Preparation of samples

Out of the material there have been cut samples for the ignitability apparatus.
The samples were kept in a climate 23/50 until they reached constant weight.

3. Arrangement of samples -freely suspended-

Flaming in warp and in weft direction / side A and side B

4. Date of test CW 30 in 2020

5. Results

PN 31629: flaming side A in weft direction	edge-test						surface-test						Dim
samples no.	1	2	3	4	5	6	1	2	3	4	5	6	
ignition ¹⁾	1	1	1	1	1	--	3	--	--	--	--	--	s
reaching the mark of measurement ¹⁾²⁾	./.	./.	./.	./.	./.	--	./.	--	--	--	--	--	s
max. flame height	6	6	4	6	6	--	5	--	--	--	--	--	cm
time	5	7	5	7	7	--	9	--	--	--	--	--	
self cessation of the flames end of afterflame ¹⁾	6	9	6	8	9	--	10	--	--	--	--	--	s
end of glowing ¹⁾	./.	./.	./.	./.	./.	--	./.	--	--	--	--	--	s
flames were extinguished after ¹⁾	./.	./.	./.	./.	./.	--	./.	--	--	--	--	--	
smoke development (visual)	little						little						./.
dropping of burning material during 20 s ¹⁾	./.	./.	./.	./.	./.	--	./.	--	--	--	--	--	s
Appearance after test: burned out till max. height 6 cm x width 2,5 cm													

PN 31629: additional tests	edge-test						surface-test						Dim
samples no.	1	2	3	4	5	6	1	2	3	4	5	6	
ignition ¹⁾	1	1	1	--	--	--	3	3	3	--	--	--	s
reaching the mark of measurement ¹⁾²⁾	./.	./.	./.	--	--	--	./.	./.	./.	--	--	--	s
max. flame height	5	5	6	--	--	--	5	5	5	--	--	--	cm
time	6	6	5	--	--	--	9	9	9	--	--	--	
self cessation of the flames end of afterflame ¹⁾	10	10	6	--	--	--	12	10	15	--	--	--	s
end of glowing ¹⁾	./.	./.	./.	--	--	--	./.	./.	./.	--	--	--	s
flames were extinguished after ¹⁾	./.	./.	./.	--	--	--	./.	./.	./.	--	--	--	s
smoke development (visual)	little						little						
dropping of burning material during 20 s ¹⁾	./.	./.	./.	--	--	--	./.	./.	./.	--	--	--	s
Appearance after test: burned out till max. height 6cm x width 2,5cm													

¹⁾ time mentioned from the beginning of the test ²⁾ during 20 Sec -/- no appearance -- no information

PN 31628: additional tests	edge-test						surface-test						Dim
samples no.	1	2	3	4	5	6	1	2	3	4	5	6	
ignition ¹⁾	1	1	1	1	--	--	3	3	3	3	--	--	s
reaching the mark of measurement ¹⁾²⁾	./.	./.	./.	./.	--	--	./.	./.	./.	./.	--	--	s
max. flame height	5	5	6	5	--	--	4	4	4	4	--	--	cm
time	6	6	20	6	--	--	7	6	6	6	--	--	
self cessation of the flames end of afterflame ¹⁾	7	8	30	8	--	--	10	9	9	9	--	--	s
end of glowing ¹⁾	./.	./.	./.	./.	--	--	./.	./.	./.	./.	--	--	s
flames were extinguished after ¹⁾	./.	./.	./.	./.	--	--	./.	./.	./.	./.	--	--	s
smoke development (visual)	little						little						
dropping of burning material during 20 s ¹⁾	./.	./.	./.	./.	--	--	./.	./.	./.	./.	--	--	s
Appearance after test: burned out till max. height 6cm x width 5cm													

PN 31630: additional tests	edge-test						surface-test						Dim
samples no.	1	2	3	4	5	6	1	2	3	4	5	6	
ignition ¹⁾	1	1	1	1	--	--	3	3	3	3	--	--	s
reaching the mark of measurement ¹⁾²⁾	./.	./.	./.	./.	--	--	./.	./.	./.	./.	--	--	s
max. flame height	3	5	3	5	--	--	3	3	4	4	--	--	cm
time	6	7	6	6	--	--	5	5	7	8	--	--	
self cessation of the flames end of afterflame ¹⁾	10	9	9	9	--	--	7	8	15	12	--	--	s
end of glowing ¹⁾	./.	./.	./.	./.	--	--	./.	./.	./.	./.	--	--	s
flames were extinguished after ¹⁾	./.	./.	./.	./.	--	--	./.	./.	./.	./.	--	--	s
smoke development (visual)	little						little						
dropping of burning material during 20 s ¹⁾	./.	./.	./.	./.	--	--	./.	./.	./.	./.	--	--	s
Appearance after test: burned out till max. height 6cm x width 3,5cm													

¹⁾ time mentioned from the beginning of the test ²⁾ during 20 Sec -/- no appearance -- no information



6. Remarks and explanations to the testing procedure - none –

7. Opinion concerning the dropping of burning material

The test for normal flammability shows no burning dripping material.